




AutoHotTM Controller On-Demand Pump Control

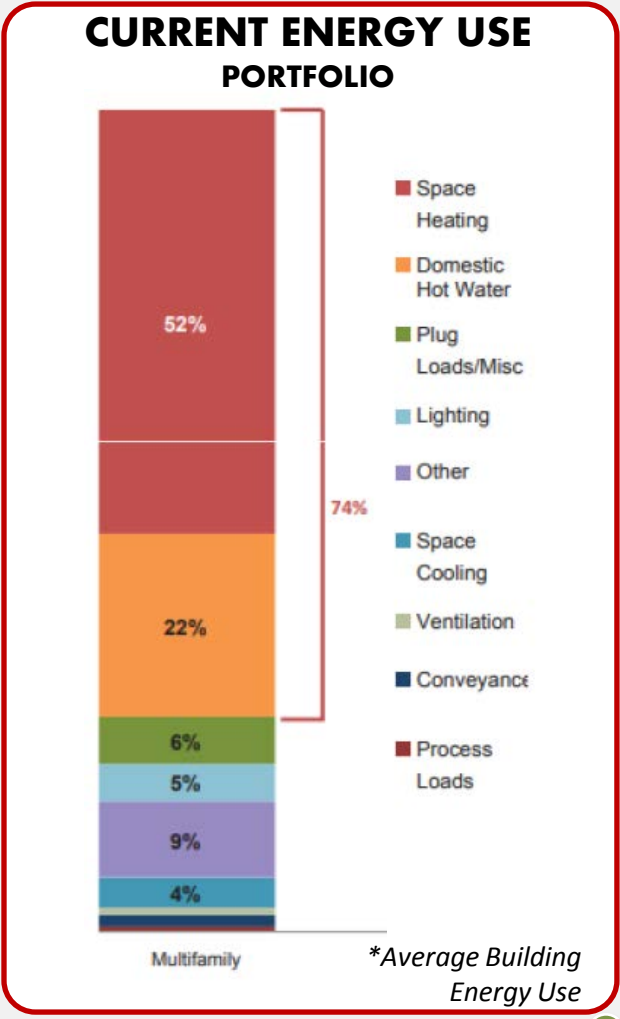

NYC ENERGY CODE

C404.6.1 *Circulation systems.*

Heated water circulation systems shall be provided with a circulation pump.

Controls for circulating hot water system pumps shall start the pump based on the identification of a demand for hot water within the occupancy. The controls shall automatically turn off the pump when the water in the circulation loop is at the desired temperature and when there is no demand for hot water.

REQUIRED
 NYC Code was updated in 2016, Inspectors are enforcing NOW